



HAZARDOUS WIRING


120 VOLT 60 HZ APPLICATION

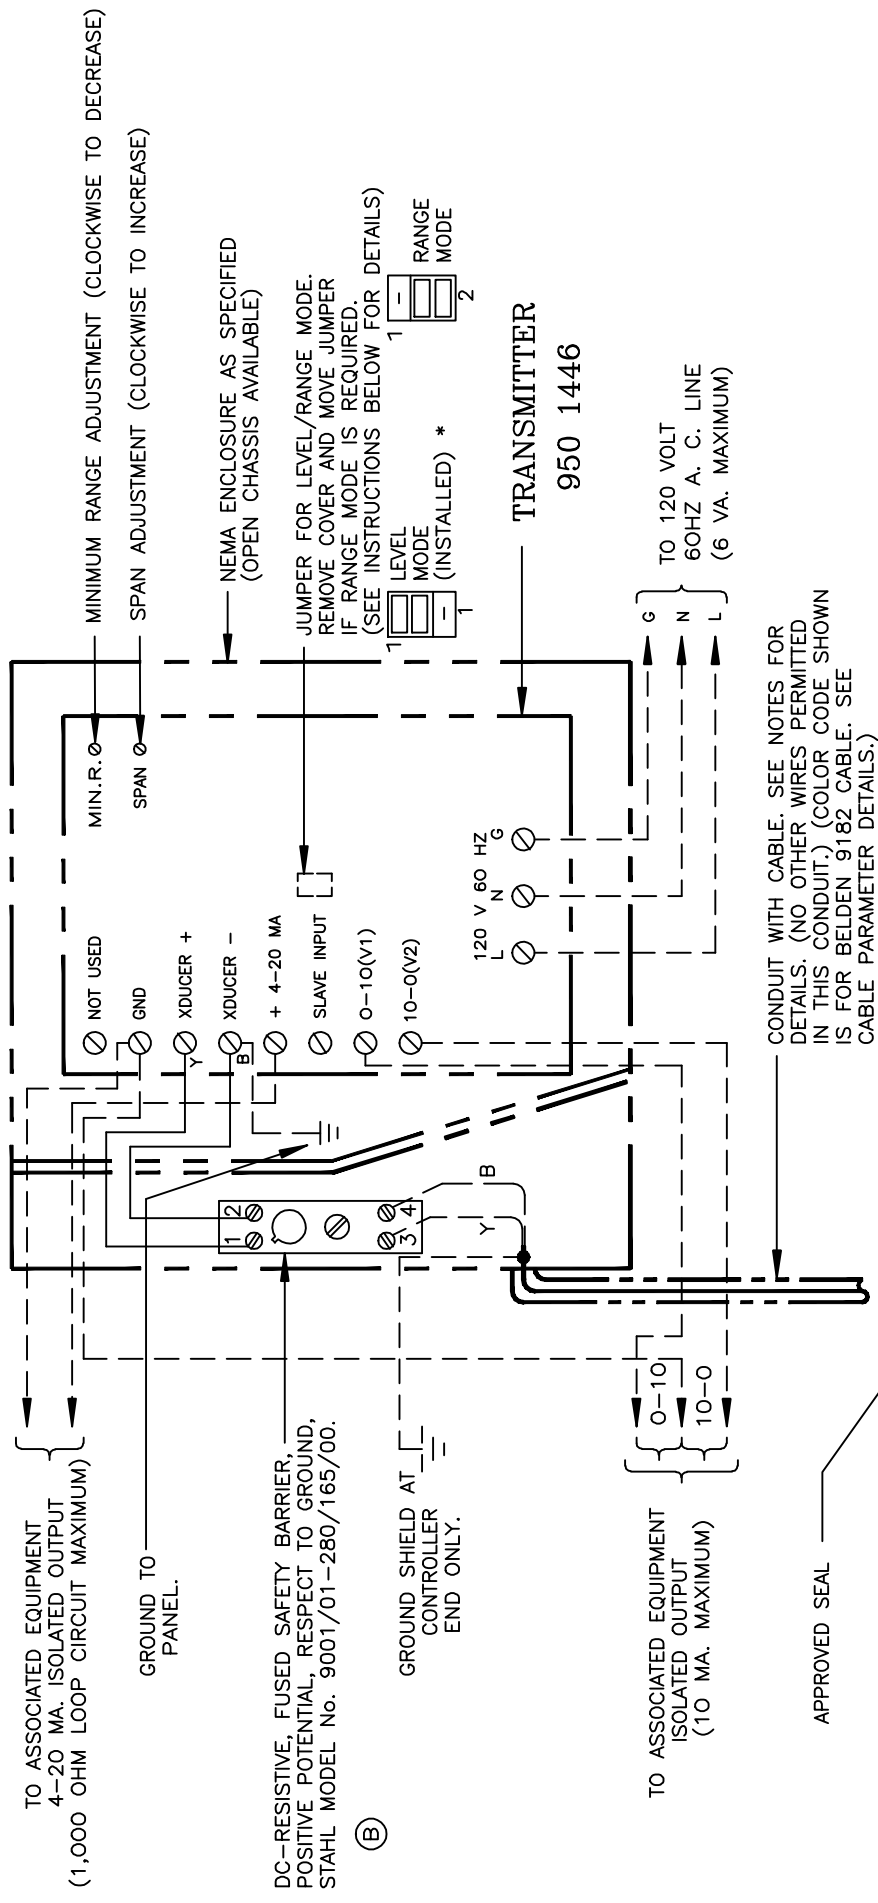

NON-HAZARDOUS LOCATION
HAZARDOUS LOCATION
CLASS I, DIV. 1, GROUP C & D
CLASS II, DIV. 1, GROUP E, F & G
CLASS III, DIV. 1

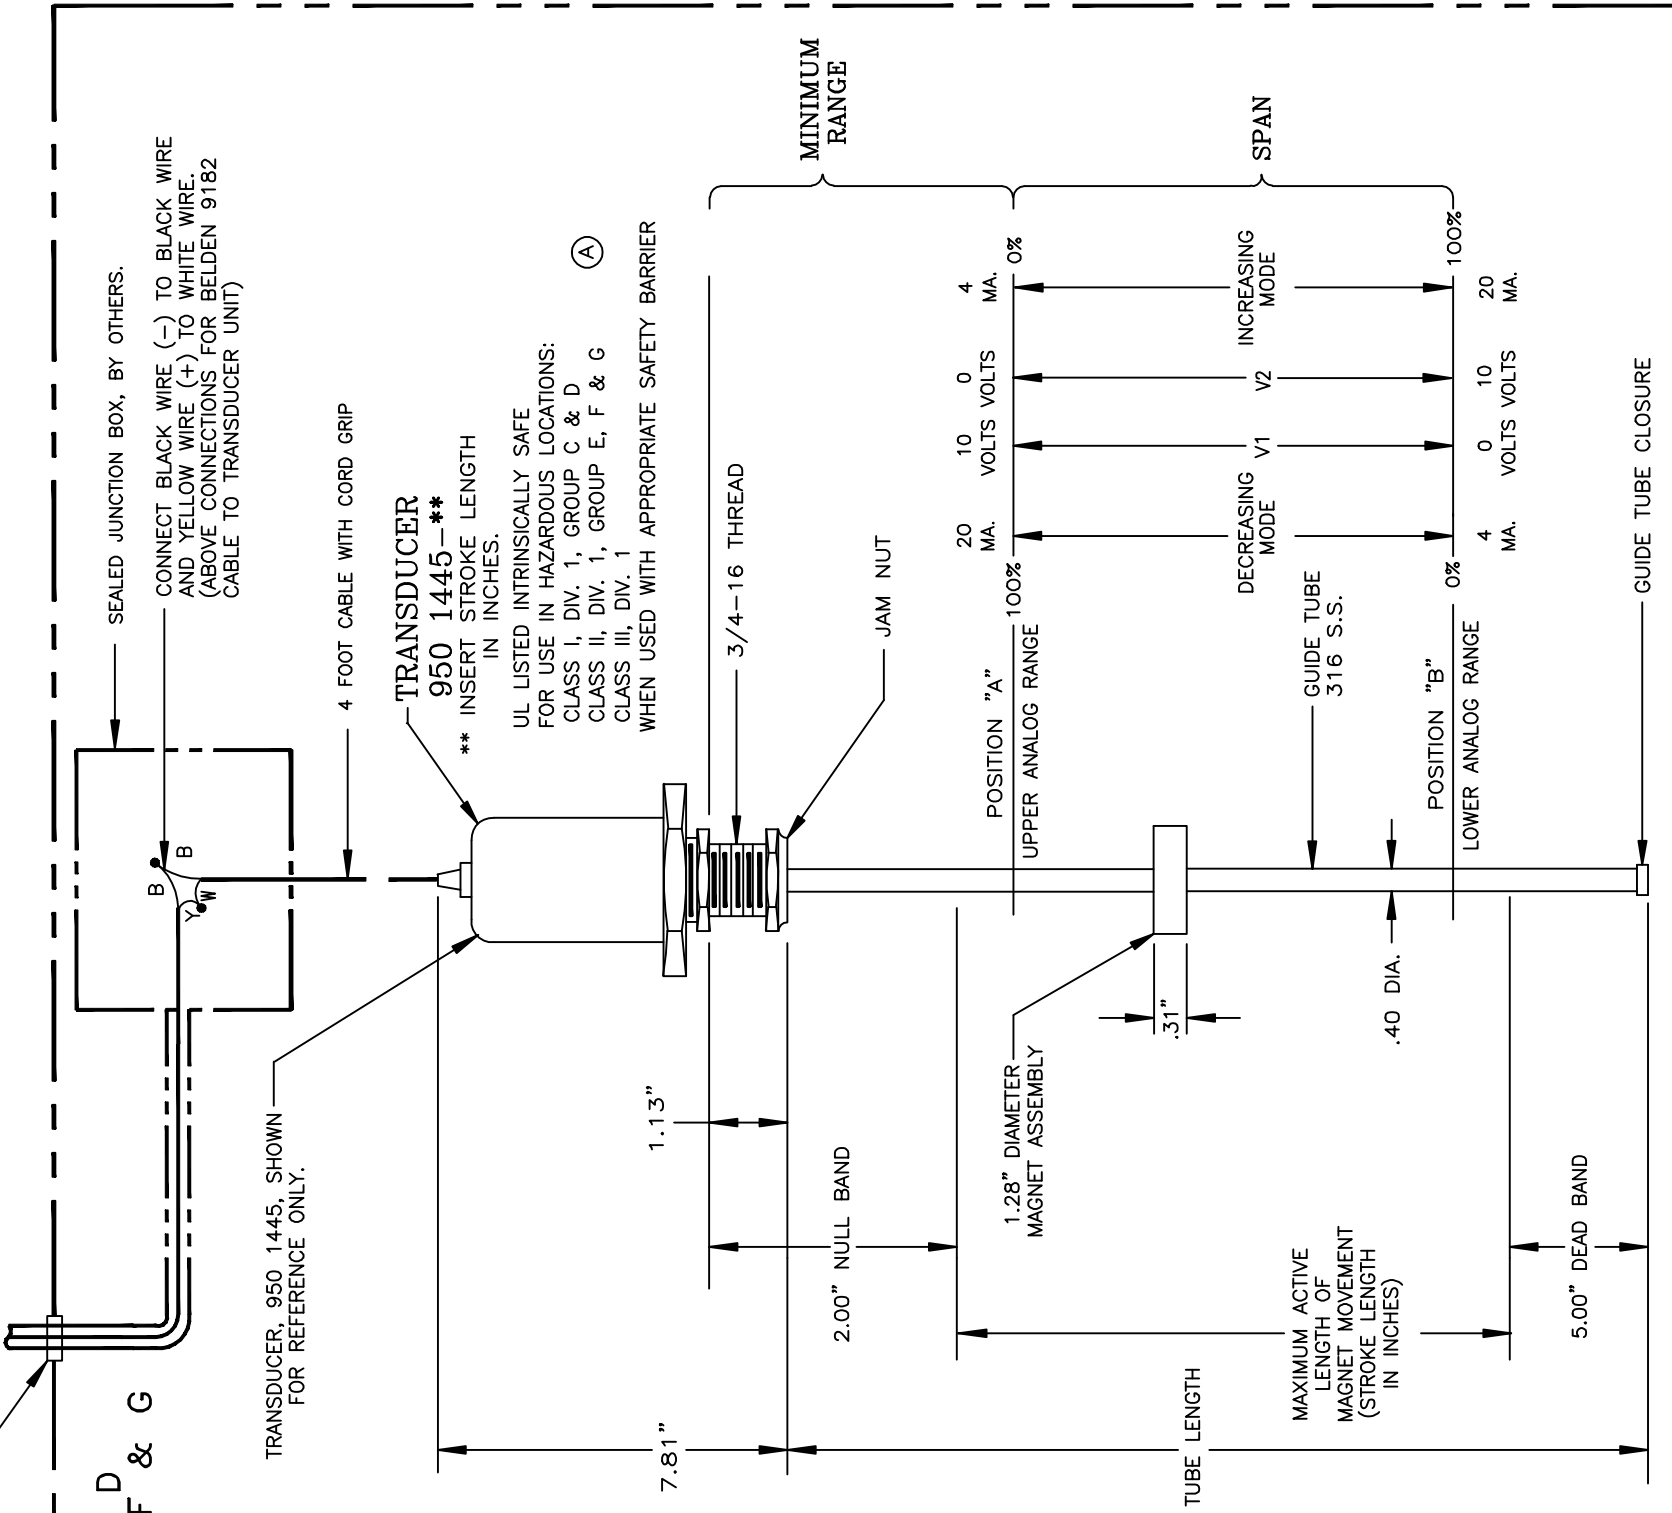

240 VOLT 60 HZ APPLICATION (OPTIONAL)

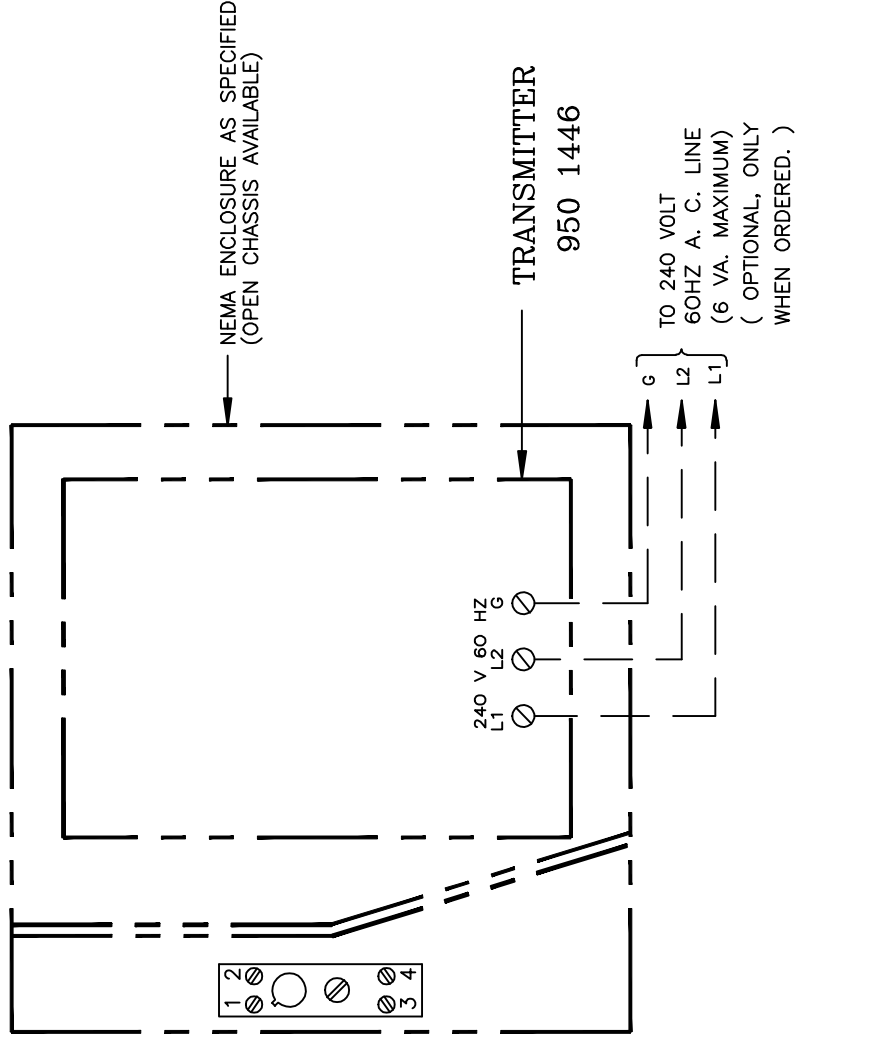

NOTES:

- CABLE PARAMETERS:
A. USE CONDUIT WITH CABLE INSIDE.
B. NO OTHER WIRES TO BE IN CONDUIT.
C. UP TO 1000 FEET- #22 AWG OR GREATER, TWISTED SHIELDED CABLE, CAPACITY LESS THAN 60 PICOFARAD PER FOOT, INDUCTANCE LESS THAN .2 MICROHENRIES PER FOOT.
D. UP TO 2500 FEET- TWIN AXIAL BELDEN 9182 OR EQUAL. (6.8 PICO FARADS PER FOOT)

CALIBRATION INSTRUCTIONS:

- POSITION THE MAGNET AT THE UPPER LIMIT OF THE ANALOG SPAN REQUIRED (POSITION A), WHILE READING OUTPUT V1 (i.e. 0-10 TO GROUND); ADJUST THE "MIN.R." ADJUSTMENT SCREW TO READ 10.00 VOLTS.
- CHANGE POSITION OF THE MAGNET TO THE LOWER LIMIT OF THE ANALOG SPAN (POSITION B), WHILE STILL READING V1, TURN THE "SPAN" ADJUSTMENT SCREW TO READ 0.00 VOLTS.
- IF THE 4. TO 20 MILLIAMPERE OUTPUT IS REQUIRED, DETERMINE WHICH MODE OF OPERATION IS REQUIRED AND SELECT THE REQUIRED POSITION OF THE JUMPER LEVEL RANGE MODE- CURRENT INCREASES ON FALLING LEVEL THE 0 TO 10 VOLT OR 10 TO 0 VOLT OUTPUTS, ARE ALWAYS PRESENT.
- THE 950 TRANSMITTER IS NORMALLY SHIPPED WITH THE JUMPER IN LEVEL MODE. THE COVER MUST BE REMOVED BY FIRST REMOVING 4 STAND-OFF SCREWS AND COVER BEFORE CHANGING THE MODE JUMPER *.

GENERAL INFORMATION

PRIOR TO INSTALLATION, POWER UP THE SYSTEM TO VERIFY OPERATION AND TO FAMILIARIZE YOURSELF WITH THE UNIT.

SEE DRAWING E-0198300-B, WHEN UL APPROVAL IS REQUIRED ON TRANSDUCER UNIT.

THE TRANSDUCER SHOULD BE HANDLED WITH CARE DURING STORAGE AND INSTALLATION.

THIRD ANGLE PROJECTION	DR. R.G.	TITLE WIRNG DIAGRAM FOR
SURFACE FINISH 63	DATE 3/15/91	TYPE 950 4-20 MA. &
TOLERANCE ALLOWANCE UNLESS OTHERWISE SPECIFIED: .0005 ON 3 PLACE DECIMALS .00005 ON 4 PLACE DECIMALS +/- .30 MIN. ON ALL ANGLES	APP.	(0-10/10-0) OUTPUTS
	DATE	120/240 VOLT ASSEMBLY
	SCALE	WITH SAFETY BARRIER.
	NONE	DRAWING NO.
		E0209500
		C

DR. R.G.	TITLE WIRNG DIAGRAM FOR
DATE 3/15/91	TYPE 950 4-20 MA. &
APP.	(0-10/10-0) OUTPUTS
DATE	120/240 VOLT ASSEMBLY
SCALE	WITH SAFETY BARRIER.
NONE	DRAWING NO.
	E0209500
	C

AMETEK
Automation & Process Technologies
Copyright © 2008. AMETEK AUTOMATION & PROCESS TECHNOLOGIES. ALL RIGHTS RESERVED. DRAWING IS UNLESS OTHERWISE SPECIFIED. UNAUTHORIZED USE, REPRODUCTION OR DISTRIBUTION IS STRICTLY PROHIBITED BY FEDERAL LAW.
Clawson, MI 48017 U.S.A.

REV.	DESCRIPTION	DATE	BY
A	WAS ACAD DRAWING AND UL NOTE ADDED	8/31/94	RG
B	UPDATED TO NEW SAFETY BARRIER	5/13/97	WAK
C	UPDATED LOGO IN TITLE BLOCK	10/22/08	MJD